


D66 A 1153

ISSUE
A

IF IN DOUBT-ASK
DO NOT SCALE

FIRST W.O.

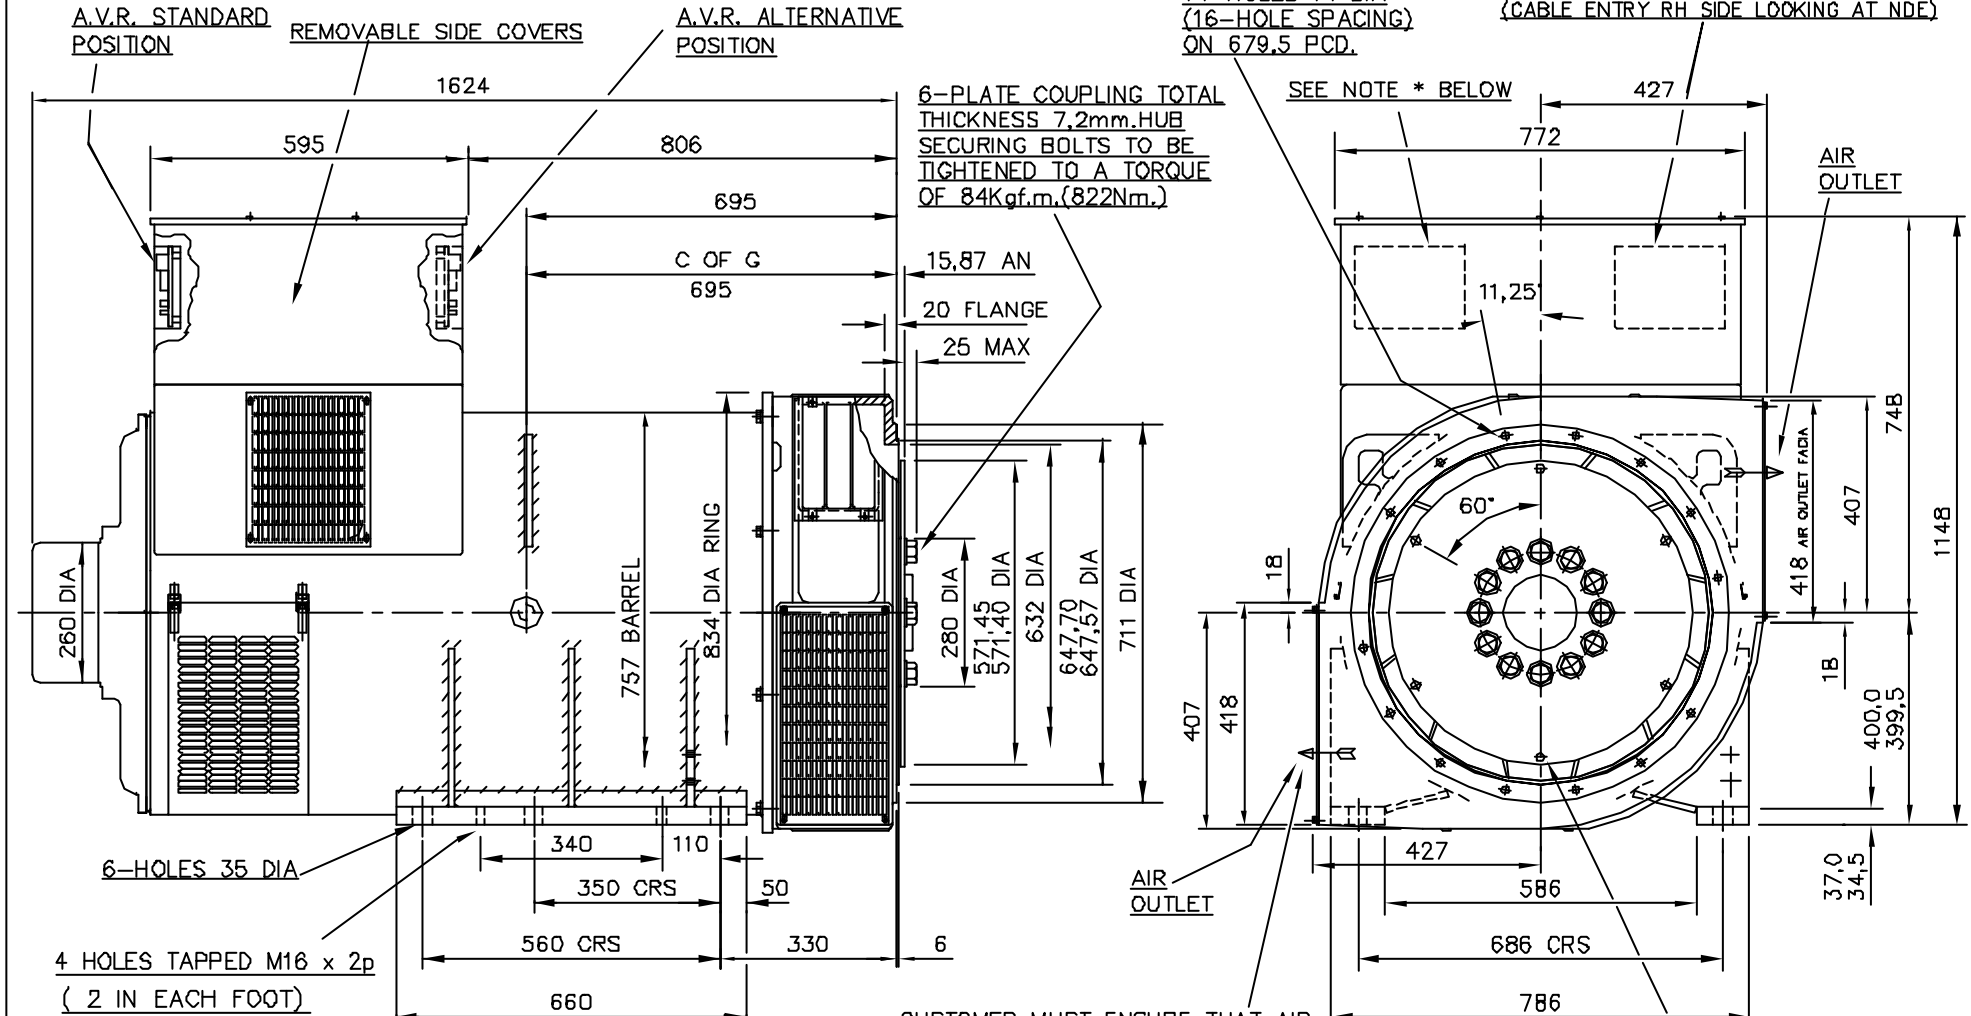

CUSTOMER MUST ENSURE THAT AIR INLET AND OUTLET POSITIONS ARE NOT OBSTRUCTED.

6-HOLES IN COUPLING 16,7 DIA EQUI-SPACED ON 543 PCD

* TOLERANCE ON CRS IS AS PER IS 2102 (PART 1) 1993 -MEDIUM CLASS

NOTE:-
CUSTOMER MAY CUT CABLE ENTRY HOLES AS REQUIRED IN ANY OF THE FOUR TERMINAL BOX SIDES SUBJECT TO POSITION OF AVR. TERMINALS. ETC.

* POSITION OF AVR WHEN CABLE ENTRY ON LH SIDE LOOKING ON NDE

CERTIFIED PRINT (ONLY IF SIGNED)		HCK6Z 1-BEARING ADAPTOR SAE 0 COUPLING SAE 18	SCALE	FIRST W.O.
BY			1:10	UNIT OF MEASUREMENT MILLIMETRES (mm)
DATE		NEWAGE INTERNATIONAL Ltd STAMFORD ENGLAND	D66 A 1153	ISSUE
DRAWN	R.MAC/28:07:00			A
CH'D				
APP'D				

---	A	R.MAC	28:07:00	ORIGINAL ISSUE
MOD.	ISS.	DRN.	DATE	ALTERATION